



1	2	3	4	5	6	7	8
				DATE	DESCRIPTION OF CHANGE		REV
				2021-05-20	XXXXX		A
				2021-05-21	Wiring diagram optimization		B

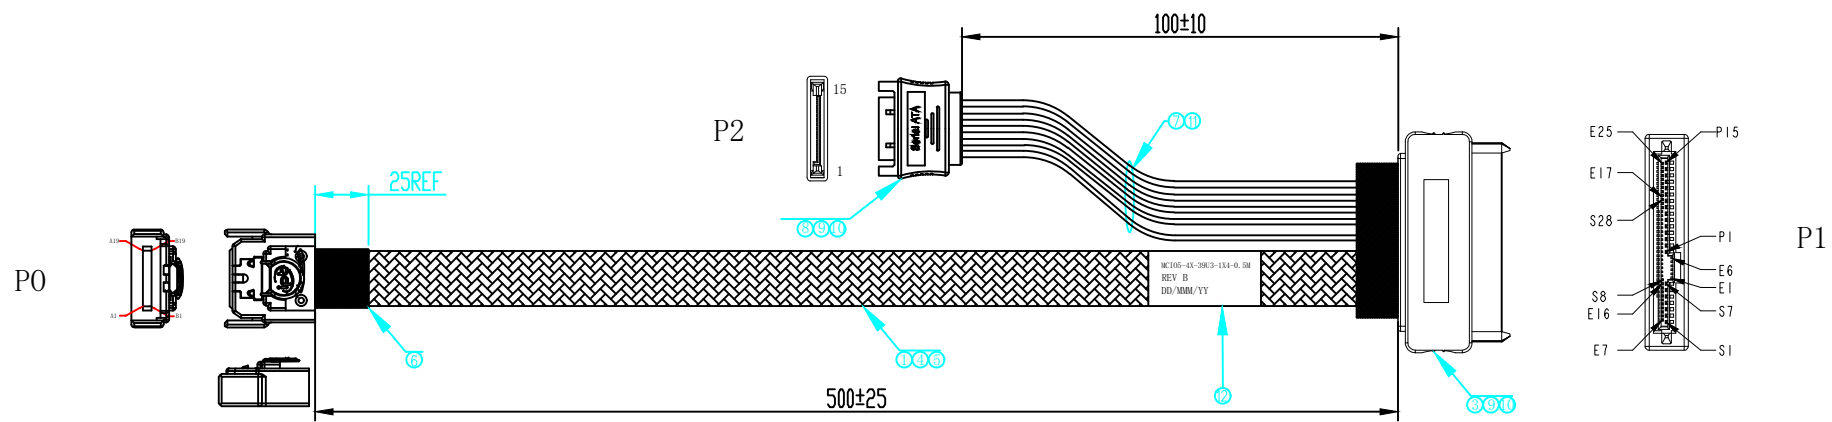

- TEST CONDITIONS:
1. 100% OPEN & SHORT & MISS—WIRING & INTERMITTENCE TEST
 2. CONDUCTIVE RESISTANCE: 3 Ω MAX.
 3. INSULATION RESISTANCE: 10 Ω M
 4. HI-POT TEST: 300VDC FOR 10ms.
 5. THIS PRODUCT MEETS PCIE 5.0


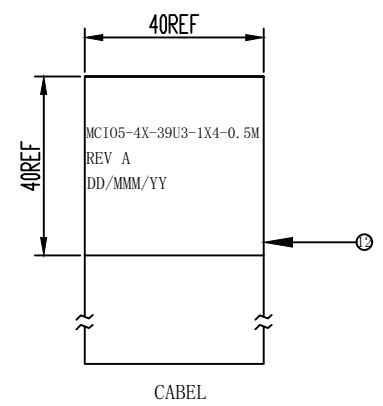


⑫	CABEL	CABEL : 40*40MM	1	PCS	
⑪	WIRE	WIRE 1007 24AWG STRANDED	-	MM	
⑩	External Mold	PVC 45P BLACK	-	G	
⑨	Internal Mold	PE See through	-	G	
⑧	Connector	SATA15P M PRS LCP BLK	1	PCS	
⑦	WIRE	WIRE: UL1007 18AWG 4IC BLK/RED/YEL	-	MM	
⑥	Adhesive tape	IERMLENE CLOTH TAPE, T=0.11mm. BLK.	-	MM	
⑤	Network manager	EXPANDO TUBE: OD=7MM, BLACK, VW-1,	-	MM	
④	WIRE	WIRE: UL1571 30AWG	-	MM	
③	Connector	SFF-8639 PCIE 68POS CONN, STR, BLACK	1	PCS	
②	Connector	MICO STR With shrapnel	1	PCS	
①	CABLE	SAS 30AWG*2C+2D+A+HM PLATED	-	MM	
NO.	NAME	IPT NO.	DESCRIPTION	Q' TY	Q' TY

TITLE	MCI0 4X TO 8639+SATA 15P CABLE U3. 1X4				SHEET	1/2	
CUSTOMER		CUSTOMER P/N	MCI05-4X-39U3-1X4-0.5M	DRAWING	<i>lupeng</i>		
DWG NO.	WIPT20210520003	UNIT	SCALE	REV	VIEW	CHECKED	<i>lupeng</i>
IPT P/N		mm	NONE	B		APPROVAL	

5	6	7	8
DATE	DESCRIPTION OF CHANGE		REV
2021-05-20	XXXXX		A
2021-05-21	Wiring diagram optimization		B

WIRING DIAGRAI

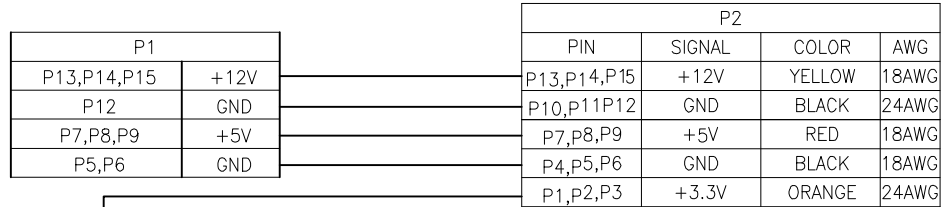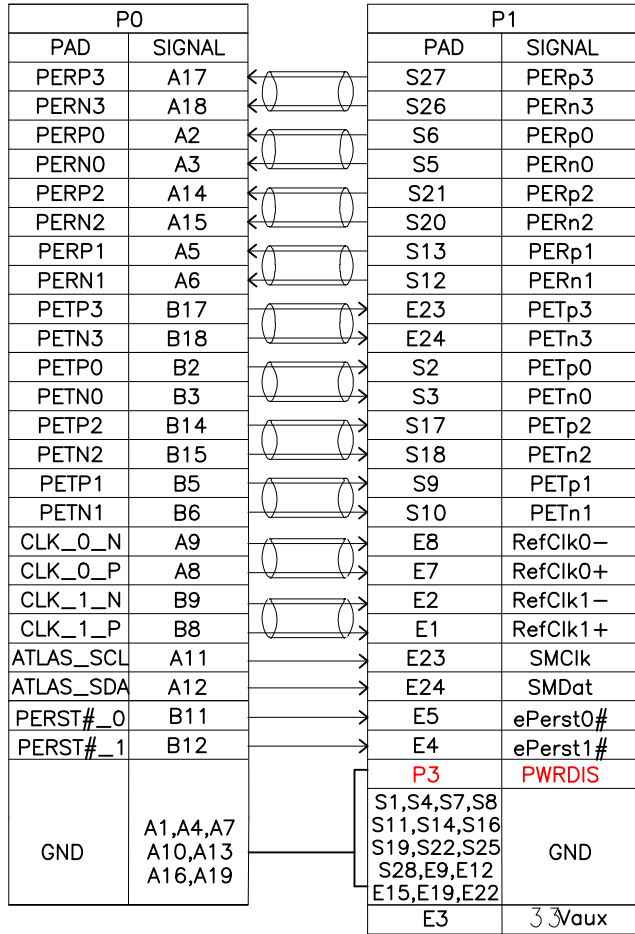

- ★ 1. The P3 Angle of P1 is grounded
- 2. P1 of E25 is open

TITLE	MCIO 4X TO 8639+SATA 15P CABLE U3. 1X4					SHEET	2/2
CUSTOMER			CUSTOMER P/N	MCIO5-4X-39U3-1X4-0. 5M	DRAWING	<i>lupeng</i>	
DWG NO.	WIPT20210520003	UNIT	SCALE	REV	VIEW	CHECKED	<i>lupeng</i>
IPT P/N		mm	NONE	B		APPROVAL	